
Vision Fire & Security

VESDA®

Refrigerated Storage **Design Guide**

March 2006

Copyright

This document is protected by copyright under the laws of Australia and other jurisdictions throughout the world. It must not by any means, either in whole or part, be reproduced, communicated to the public, adapted, distributed, sold, modified, published except as permitted by any laws or statute or with prior written consent of Vision Fire & Security Pty Ltd.

Copyright ©2006 Vision Fire & Security Pty Ltd ABN 25 008 009 514

Disclaimer

The manufacturer reserves the right to change designs or specifications without obligation and without further notice. VESDA, LaserTEKNIC, LaserPLUS, LaserSCANNER, LaserCOMPACT, LaserFOCUS, VESDAnet, VESDALink, ASPIRE, ASPIRE2, AutoLearn, VSM, PSM, VConfig, InfoWORKS, PROACTIV, PRECISION, VSC, ADPRO, FastTrace, FastVu, FastScan, Axiom, PRO, Amux and Video Central are trade marks used under licence by the distributor.

Contents

1. Introduction	1
1.1 About This Design Guide	1
1.2 Quick Reference.....	1
2. Background Information	2
2.1 Fire Safety Considerations In Refrigerated Storage Facilities	2
2.2 Performance-Based Design	3
2.3 Key Design Considerations	3
2.4 Why Use VESDA Smoke Detection?	4
3. Designing For Effective Fire Protection	4
3.1 Sample Pipe Material	5
3.2 Positioning Pipes And Sample Holes.....	5
3.3 Sample Pipe Insulation.....	7
3.4 Sealing Sample Pipe Penetrations.....	7
3.5 Compensating For Sample Pipe Contraction.....	8
3.6 In-rack Protection	9
3.7 Ceiling Void Protection	9
3.8 Other Areas To Be Protected.....	10
4. Preventing Condensation And Crystallization.....	10
4.1 The Effects Of A Temperature Drop	10
4.2 Condensation On The Sample Pipe Outer Surface	10
4.3 Crystallization On The Sample Pipe Outer Surface	11
4.4 Condensation Inside Sample Pipes	11
4.5 Crystallization Inside Sample Pipes	12
5. Installation Considerations.....	12
5.1 Sampled Air Warming	12
5.2 Heat Tracing.....	14
5.3 Exhaust Air Treatment.....	14
5.4 Water Traps.....	15
5.5 Integration With Pre-action Sprinklers.....	15
5.6 Battery Backup	17
6. Ongoing Considerations	17
6.1 Running The VESDA System	17
6.2 System Commissioning.....	18
6.3 Service And Maintenance	18
7. Appendix – Heat Tracing.....	19
8. References.....	21

1. Introduction

1.1 About This Design Guide

Vision Systems Ltd has produced this Design Guide as a reference, to be consulted when designing and specifying VESDA fire protection solutions for freezers, cold storage areas and loading bays with temperatures ranging from minus 40°C (-40°F) to 18°C (65°F)^[1].

Unlike most commonly used passive fire detection devices, VESDA detectors are able to function in sub-zero climates without losing their very early warning smoke detection capabilities. For this reason, they have been extensively used in refrigerated storage facilities for many years and are, in fact, the only Factory Mutual (FM) approved smoke detection and fire suppression activation system for such facilities.

In this Design Guide we will discuss the relevant design considerations and make recommendations regarding the most effective way in which to install a VESDA solution in the particular refrigerated storage facility for which it is being designed.

Important Note: The information contained in this Design Guide should be used in conjunction with specific local fire codes and standards. Other regional industry practices, where applicable, should also be adhered to.

1.2 Quick Reference

The key design considerations presented in Table 1 are an overview only. They should be used in conjunction with the remainder of the information presented in this Design Guide and in the relevant VESDA System Design Guide^[2].

Table 1 – Key design considerations for a VESDA system in a refrigerated storage facility.

Component	Key Design Considerations	Detailed Information
VESDA Pipe	Pipe material and insulation must be suitable for low temperatures.	Sections 3.1, 3.3 and 3.5
	All connections in the pipe network must be air-tight.	Sections 3.4, 3.5 and 4.4
	Sampled air MUST NOT be subjected to vastly differing sub-zero temperatures within the freezer area.	Sections 3.5, 4.1, 4.2 and 4.3
	The integrity of the freezer must be maintained at all sample pipe entrance points.	Section 3.4
	VESDA exhausted air must be returned to the protected zone.	Section 5.3
	Only use water traps where the external temperature is lower than within the protected zone.	Sections 4.4 and 5.4
Sample Holes	Avoid placing sample holes close to the freezer entrances.	Sections 3.2 and 4.3
	Avoid sampling directly from the path of the chiller air supply.	Section 3.2

Table 1 Continued.

Component	Key Design Considerations	Detailed Information
VESDA Detector	Detectors must be installed outside the protected zone.	Section 1.4
	Detectors must be installed inverted, to prevent water entering them via the pipe network.	Sections 3.4 and 4.4
	Sampled air can be warmed where necessary. Consider a method.	Sections 5.1 and 5.2
	Consider the battery backup required.	Section 5.5
Integration With Pre-action Suppression	Installing VESDA with a pre-action sprinkler systems.	Section 5.6

2. Background Information

2.1 Fire Safety Considerations In Refrigerated Storage Facilities

According to statistics, released by the NFPA^[3], the major fire risks within a refrigerated storage facility arise from the following:

- Electrical or mechanical faults in conveyor and other transport equipment.
- Electrical equipment, wiring and other equipment housed in the roof space.
- The lighting system.
- Hot spots resulting from maintenance operations.
- Discarded cigarette butts.
- Arson.

Due to the large amounts of plastic present in this type of facility, in the form of packaging materials, a fire would produce large amounts of highly toxic and corrosive smoke which would damage assets and endanger personnel. The large amounts of fuel available, in the form of stock and the highly flammable light weight sandwich panels from which such facilities are constructed, would also cause fires to spread quickly from one area to another. Table 2 provides guidelines for those areas in a refrigerated storage facility that it is essential to protect.

Table 2 – Guidelines for areas to be protected.

Area	Essential	Recommended	Optional
Freezers/Chiller Rooms	✓		
Coolers	✓		
Plant and Maintenance Areas	✓		
Return Air Path Under the Protected Area		✓	
Loading Bays and Surrounding Areas	✓		
Office/Monitoring Area			✓
Ceiling/Roof Voids	✓		
Within Racks			✓

In cases where a pre-action sprinkler system is to be included as part of the fire protection, the VESDA system can be used to activate the release mechanisms as discussed in section 5.6.

2.2 Performance-Based Design

The flexibility of Performance-Based Design allows the fire protection system to be tailored to the specific requirements of each individual refrigerated storage environment, with the commercial drivers to manage the risks.

Detector spacing or, for a VESDA pipe, sample hole spacing is traditionally dictated by local prescriptive codes and standards. In a more performance-based approach, each installation is assessed according to its specific environmental conditions (ceiling height, airflow rate, expected temperature range etc). Sample hole spacing and location can then be altered easily to suit the particular performance requirements. Appropriate VESDA alarm sensitivities are determined by conducting in-situ smoke tests and evaluating the system response.

Performance-based design concepts can be used in most countries as they adhere to many international fire engineering guidelines, such as those listed below:

- International Fire Engineering Guidelines (Edition 2005)^[4].
- British Standard BS7974^[5].
- SFPE Engineering Guide to Performance-Based Fire Protection^[6].

While this alternative fire protection solution can be made to comply with local and national codes and standards, for buildings and life safety, assessments of the environmental risks and performance requirements, specific to the particular refrigerated storage facility, are also conducted as part of the design process.

Standard risk management concepts, like those listed below, are also often used for refrigerated storage facility assessment:

- AS/NZS 4360, 1999^[7].
- SFPE Handbook Third Edition, 2002^[8].

Note: The SFPE Code Officials' Guide to Performance-Based Design Review^[9] is a very good source of information for Authorities Having Jurisdiction (AHJs) reviewing and assessing a VESDA system design for a refrigerated storage facility.

2.3 Key Design Considerations

For the purposes of this Design Guide, the following temperature ranges apply to the various areas to be protected:

- Freezers -40°C to -15°C (-40°F to 5°F).
- Chillers -9°C to 2°C (16°F to 36°F).
- Coolers and Loading Bays 0°C to 18°C (32°F to 65°F).

Important Note: VESDA Detectors MUST NOT be installed in sub-freezing environments.

A fire protection system designer would normally ask the following questions, when specifying and designing a VESDA smoke detection system in a refrigerated storage facility:

1. What level of protection is required and how will fire safety be managed?
2. Is the integrity of the pipe network adequate with respect to being air-tight?
3. What temperature range and humidity will be experienced by pipes within the refrigerated storage facility, pipes in any other areas to be protected and the detectors themselves?
4. Are there likely to be any future changes with regard to the function of the area due to demand or operational needs? For example, might a refrigerated storage facility be converted to a cold storage area?

5. What are the airflow characteristics of the protected areas, entrances and loading bays?
6. What are the pipe insulation requirements?
7. What effects might the defrost cycles and associated condensation have on fire protection?
8. What is the possibility of condensation occurring both within and on the outside of the pipe network?
9. What is the configuration of racking within the areas to be protected?
10. How well sealed are the wall and ceiling insulation panels?
11. Is pre-action suppression to be included in the fire protection system and, if so, how will it be integrated with the VESDA system?

2.4 Why Use VESDA Smoke Detection?

VESDA Aspirating Smoke Detection (ASD) systems have been used to protect refrigerated storage facilities for many years. Most fire protection technologies which are designed to operate in freezing conditions are not capable of early warning detection and are prone to being damaged by equipment such as forklift trucks. The very early warning capability of VESDA detectors means that they are able to detect the incipient (pre-combustion) stage of a fire which drastically reduces business disruption, asset damage and the potential risks to the safety of personnel. The design flexibility of VESDA systems also allows them to be used for the automatic activation of pre-action suppression, both gaseous and sprinkler.

The combustible nature of the types of materials normally stored in refrigerated environments, combined with the very dry high airflow in such environments, creates a significant fire risk. Fires will spread rapidly between cardboard or plastics packaging, grease impregnated materials, food stuffs and wooden pallets. Hence, the earlier a fire can be detected the better.

The perishable nature of the goods, commonly stored in freezers or coolers, makes it essential that any rise in temperature be avoided. Heat from a fire or a rise in temperature due to refrigeration system down time, following a fire, would both result in stock spoilage and hence loss of revenue. Even an incipient fire, in this type of environment, can lead to significant losses if not detected and managed early. Stock exposed to low levels of smoke over an extended period of time will become contaminated.

Other advantages of the VESDA system are that, with a properly designed system, performance will be reliable and little influenced by condensation or the high airflows caused by blast chillers.

The deficiencies of other detector technologies in low temperatures are recognized by many international codes and standards which regulate against the use of them in environments where the ambient temperature is less than 0°C (32°F)^[10]. Linear heat cables are permitted in freezers but are prone to damage by forklift trucks and other common work procedures. Since VESDA detectors are installed outside the protected area, only the sample pipe network is exposed to sub zero temperatures. Being on the ceiling and inside voids makes it unlikely that the VESDA sample pipes will be damaged.

Note: Unlike the FM approved VESDA system, linear heat cables are specifically for the activation of pre-action suppression and cannot simultaneously provide the very early warning smoke detection which may prevent the need for suppression.

3. Designing For Effective Fire Protection

In this section, design methodologies will be described with consideration for the different requirements depending on the function of the particular area being protected.

Important Note: The latest version of ASPIRE2™, the VESDA sample pipe modelling program, should be used for all pipe network designs.

3.1 Sample Pipe Material

The choice of pipe material will depend on where the pipe is to be located. For instance, installation of ceiling mounted pipes can be made easier by using long lengths of pipe material suited to coping with low temperatures and internal temperature fluctuations. Such materials include the Halogen-free Fire-retardant high Temperature (HFT) plastics, Acrylonitrile Butadiene Styrene (ABS) and High Density Polyethylene (HDPE). Suitable materials and their properties are presented in Table 3 below.

Table 3 – Properties and recommended applications for pipe materials^[11-14].

Material	Operating Temperature	Thermal Contraction	Recommended Applications
PVC	-18°C (-40 to 120°F)	7.0 mm per 10 m per 10°C (0.28" per 32.8 ft per 18°F)	Above -18°C (0°F)
HFT	-40 to 140°C (-40 to 284°F)	7.0 mm per 10 m per 10°C (0.28" per 32.8 ft per 18°F)	Above -40°C (-40°F)
ABS	-40 to 80°C (-40 to 176°F)	10.1 mm per 10 m per 10°C (0.4" per 32.8 ft per 18°F)	Above -40°C (-40°F)
CPVC	-18 to 94°C (0 to 201°F)	6.7 mm per 10 m per 10°C (0.26" per 32.8 ft per 18°F)	Above -20°C (0°F)
PE-80	-50 to 60°C (-58 to 140°F)	20 mm per 10 m per 10°C (0.79" per 32.8 ft per 18°C)	Above -50°C (-58°F)
PE-100	-50 to 60°C (-58 to 140°F)	13 mm per 10 m per 10°C (0.52" per 32.8 ft per 18°F)	Above -50°C (-58°F)

An added advantage of using a continuous semi-flexible pipe material such as HDPE^[14] is the reduction in the number of pipe junctions required.

3.2 Positioning Pipes And Sample Holes

The various international codes and standards specify detection point spacing or maximum area of coverage per detection point for a variety of different airflow rates, ceiling heights and structures etc. In compliance with these prescriptive regulations, VESDA sample holes would be located in the same positions as individual smoke detection devices. Alternatively, with reference to local codes, the pipe and sample hole configuration can be determined by satisfying performance-based design requirements.

Note: For Factory Mutual (FM) approved, refrigerated storage, VESDA installations the sample holes should be placed as for heat detectors as outlined in the latest edition of the FM 8-29 Datasheet and Memorandum 0805^[1, 15].

Sample hole locations are usually represented by a grid like that shown below (Figure 1). The letter X represents the sample hole spacing required according to local codes and standards.

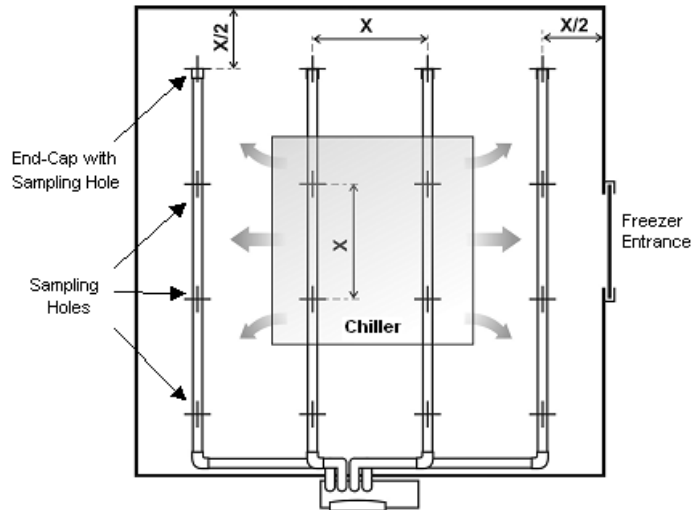


Figure 1 – Top view of a grid layout for VESDA sample holes.

In some freezers, depending on the effectiveness and frequency of defrosting management, ice will build up around the entrances. Under these circumstances, VESDA sample holes in the immediate proximity may become blocked by ice. This is normal and can be managed by specifying an appropriate system airflow fault threshold. The effects of blocked sample holes could be compensated for as follows:

- By placing the sample hole closest to the entrances as far away as is legally permitted by local codes and standards.
- By partial in-rack sampling near the entrances. Ice build-up is usually at the ceiling above the doorways, seldom within the racks.
- By placing VESDA pipes away from the path of chiller air supplies.

Note: Sample hole diameter MUST be larger than 3 mm.

Referring to the grid layout shown above (Figure 1), there are two alternative approaches to pipe network configuration design for optimal air sampling performance:

1. The pipes can be run along the ceiling inside the area to be protected as shown (Figure 2). This technique minimizes the number of pipe penetrations through the walls or ceiling and can be applied in most practical situations. Sample holes MUST be drilled after installation in this case.
2. The pipes can be positioned outside the area to be protected with smaller diameter capillary tubes (16 mm (3/4 inches) outer diameter) fed through the ceiling insulation into the protected area as shown (Figure 3). This method requires one ceiling penetration per capillary tube and more pipe connections. All penetrations must be adequately sealed to prevent the formation of ice resulting from the entry of humid air or condensation. This approach is only appropriate where the refrigerated storage facility has a ceiling void. The capillary sampling tubes should be as short as possible; less than 4 m (13 ft) being recommended. They MUST also be sealed during installation.

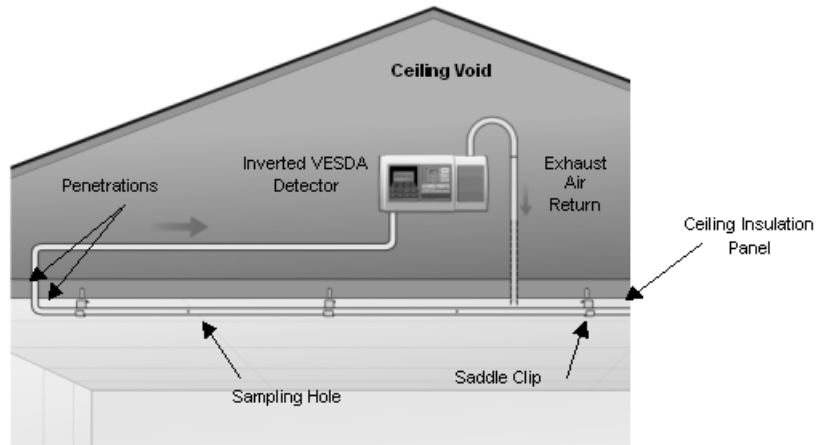


Figure 2 – Ceiling mounted VESDA pipes.

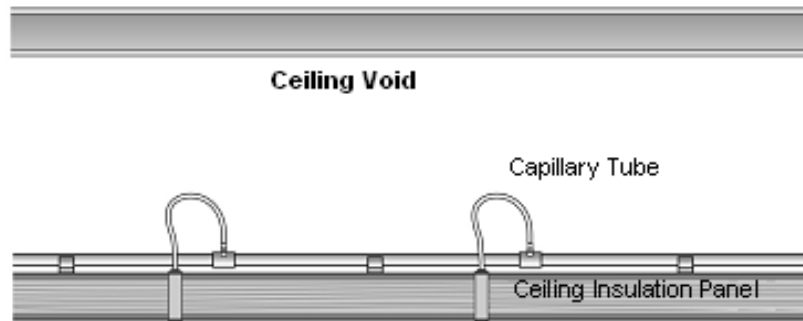


Figure 3 – Example of capillary air sampling.

Note: It is recommended that all drilling of penetration points, and the sealing of such points, be performed by appropriately experienced personnel.

3.3 Sample Pipe Insulation

Where pipe insulation is needed, use a material such as Armaflex or similar. Armaflex insulation has a temperature range of -40°C (-40°F) to 105°C (221°F), a density of 88 to 105 kg/m^3 and is very flexible. For a 25 mm ($0.98''$) internal bore pipe, a single layer of insulation 9 mm ($0.35''$) thick is adequate.

3.4 Sealing Sample Pipe Penetrations

Pipe penetrations, through ceiling or wall insulation panels **MUST** be properly sealed with a solid (Urethane foam) and/or flexible (mastic) material. To enhance air-tightness, a seal and/or insulation boot could also be installed at the penetration point as shown below (Figure 4). Consult local Wall Panel Suppliers for more detailed instructions.

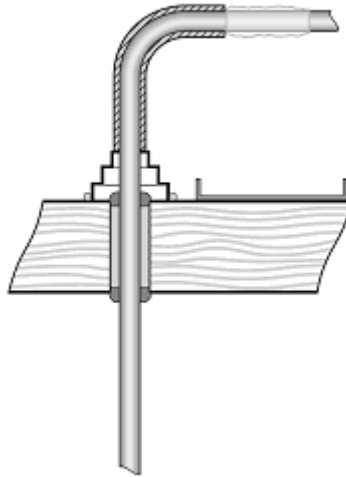


Figure 4 – Example of pipe penetration with an insulation boot and drip tray

In order to avoid condensation formation at the penetration point, the section of pipe exiting the protected area **MUST** be insulated as shown (Figure 4). A tray can be used to collect any water condensation on the pipe surface.


3.5 Compensating For Sample Pipe Contraction

Mounting clips, used to secure VESDA pipes to the ceiling, **MUST** not restrict longitudinal movement of the pipes as they expand or contract due to temperature variations. This is especially important where the pipe network is installed before the refrigerators are turned on. For example, according to its thermal expansion coefficient, an ABS pipe will contract by 0.1% for every 10°C (50°F) drop in temperature. This equates to a 40 mm (1.57 inch) reduction in length for a 40 m (131.2 ft) pipe and will result in disconnection of pipe sections in cases where the pipes were installed in temperatures well above the intended operating temperature.

Note: Refer to Table 3 for the thermal properties of other commonly used pipe materials.

To prevent pipe disconnections, make allowance for pipe contraction along the length of the pipes.

Saddle or offset clips should be used to secure the VESDA pipes to the ceiling as shown below (Figure 5).

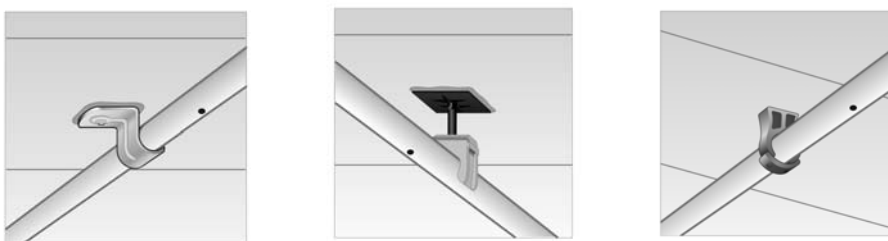

Saddle Clip

Offset Clip

Pipe Clip (UK)

Figure 5 – Examples of pipe network supports.

Offset clips are preferable since they attach to the ceiling via an adhesive pad and, if required, can be screwed on to the ceiling. The design of offset clips also allows easy movement of the pipes during expansion or contraction.

To further minimise the possibility of pipe disconnections, pipe mounting clips **MUST** not be positioned next to pipe joiners. Clips **MUST** also be more than 300 mm from the ends of the pipes so that a pipe contraction will not cause its end caps to be forced off.

3.6 In-rack Protection

In most cases, placing a VESDA pipe network on the ceiling is all that is needed. However, sample pipes can also be located along the racks used for storage in the refrigerated area as shown below (Figure 6).



Figure 6 – Example of in-rack air sampling.

Wherever possible, the in-rack sample pipe should enter the protected area through the wall at the height that the pipe will be positioned in the rack.

Note: Capillary air sampling is not recommended for in-rack sampling.

3.7 Ceiling Void Protection

Very early smoke detection is essential due to the high incipient fire risk presented by the electrical cabling and refrigeration control equipment normally housed in the ceiling void. Some local codes and standards specify that ceiling void protection must be a component of the fire protection system.

The sample hole spacing is determined, with reference to local codes and standards, according to the grid presented earlier (Figure 1) and is shown below (Figure 7).

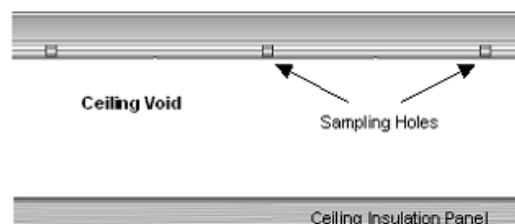


Figure 7 – Example of ceiling void air sampling.

The VESDA detectors used to protect the ceiling void MUST be configured as individual fire zones. Ceiling void pipes MUST NOT enter any other areas, nor should ceiling void detectors be used to simultaneously monitor areas outside the ceiling void.

3.8 Other Areas To Be Protected

For non-refrigerated storage areas such as those used for control, monitoring, loading and office space, the sample hole spacing and pipe network layout are identical to those for the general office environment described in the VESDA System Design Guide^[2], with reference to local codes and standards where applicable. Detector sensitivity can be adjusted to meet performance requirements.

Note: It is worth considering high sensitivity smoke detection in the areas containing refrigeration control and support equipment, since smoke or fire damage in these areas would disrupt business.

4. Preventing Condensation And Crystallization

4.1 The Effects Of A Temperature Drop

Condensation will occur when the air temperature drops below its dew point. The result is the formation of water droplets (if the dew point is above 0°C (32°F)) or ice crystals (if the dew point is below 0°C (32°F))^[16]. Inside the VESDA pipe network, condensation is unlikely and will only occur if the sampled air is cooled as it passes along the pipe through an area of lower temperature than that from which the air was sampled. On the outer surface of pipes, condensation is expected and can be tolerated.

During system design, all areas to be protected must be categorised according to the criteria listed below:

- The temperature and humidity changes that will occur if the function of the protected area is changed, for example, from a chiller to a cooler.
- The points in the pipe network which are most likely to be prone to condensation. This is done by assessing the temperature of the sampled air and the temperature of the air surrounding the sample pipe network.
- The air-tightness of the pipe network, including the detector exhaust pipe.
- The distances, from both the protected area entrances and chiller air supply paths, of both the sample pipe and sample holes.

4.2 Condensation On The Sample Pipe Outer Surface

Condensation occurs on the outer surface of the sample pipes and capillary tubes where they exit the cold storage area and enter warmer environments such as a ceiling void or other non-freezer areas. Depending on the temperature of the pipe surface, in these areas, water droplets or ice crystals will form. A water tray should be used to collect any liquid before it spills over the ceiling insulation panels as shown below (Figure 8).

Note: The water tray must be large enough to allow evaporation to occur at an acceptable rate to prevent overflow.

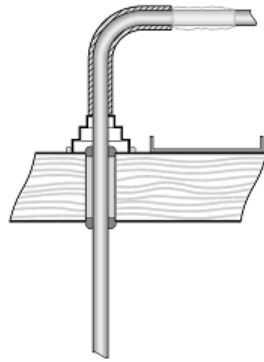


Figure 8 – Example of a water trap.

4.3 Crystallization On The Sample Pipe Outer Surface

Occasionally, ice will form on the exterior of the sections of sampling pipe close to the refrigerator entrances as shown below (Figure 9). This ice build up is normal and has no adverse effect on the operation of the VESDA system, provided that sample holes are not located in the susceptible sections of pipe where they can become blocked. Sample holes nearest to the entrances should be sprayed with silicone to prevent ice formation.

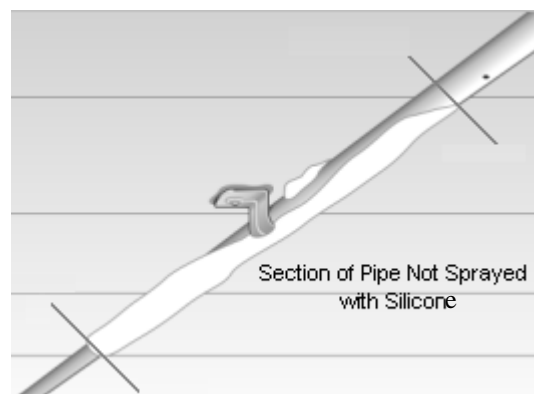


Figure 9 – Example of ice formation on sample pipes close to the refrigerator entrance.

4.4 Condensation Inside Sample Pipes

Condensation inside sample pipes, outside the protected area is rare. However, it can occur if the function of the protected area changes and/or as a result of seasonal temperature variations. For example, if a chiller (-9°C, 16°F) is converted to a cooler (8°C, 46°F), condensation may form inside the pipes outside the cooler during winter when the temperature could conceivably drop below 8°C (46°F) .

The following measures will ensure that condensation forming in the pipes does not enter the detector:

- Install the detector in the inverted position with the pipe entering it from below as shown above (Figure 2).
- Install a water trap as discussed later in section 5.4.

4.5 Crystallization Inside Sample Pipes

In order to minimise the possibility of ice plug formation inside the sample pipe, 90° elbow junctions between pipe sections should be avoided. Where it is essential to change the orientation of the pipe from horizontal to vertical, or vice versa, large radius bends should be used.

The chiller air supply is several degrees lower than the air in the rest of the chiller so, to prevent ice from forming and blocking the sample holes, sample pipes **MUST NOT** be installed in the direct path of the chiller's supply air vent. Doing so will lead to crystallisation when the warmer ambient air in the protected area enters the cool pipe. If for practical reasons, this cannot be avoided, the pipe **MUST** be insulated as shown below (Figure 10).

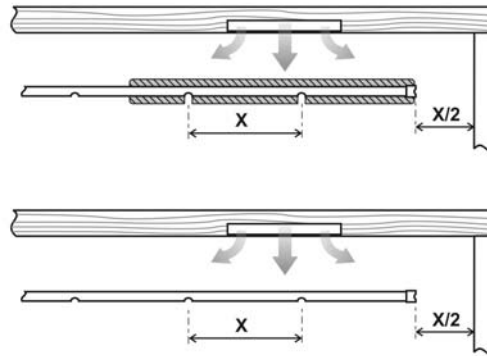


Figure 10 – Example of pipe insulation to combat ice formation in pipes directly in the path of the chiller air supply (the top is a good design, the bottom is not).

Important Note: Pipes **MUST NOT** run from a high temperature area into a lower temperature area. Separate VESDA detectors should be installed in the chiller, cooler, ceiling void, and office areas.

5. Installation Considerations

5.1 Sampled Air Warming

For optimum detection and ease of maintenance access, the VESDA detector **MUST** be installed in a location where it is unlikely to experience sub-zero temperatures. Low temperature sampled air can be easily warmed up, before it reaches the detector, by extending the sample pipe length beyond its point of exit from the cooler protected area. The warmer air outside the pipe near the detector will heat the cold sampled air within it. Usually, only a short pipe extension is necessary.

The charts below (Figure 11 to Figure 13) provide conservative estimates of the pipe extensions required, to raise the temperature of the sampled air to an acceptable value, for a number of commonly used pipe materials and range of flow rates. All calculations assume an external ambient temperature of 20°C (68°F) and a sampled air temperature of 4°C (39°F).

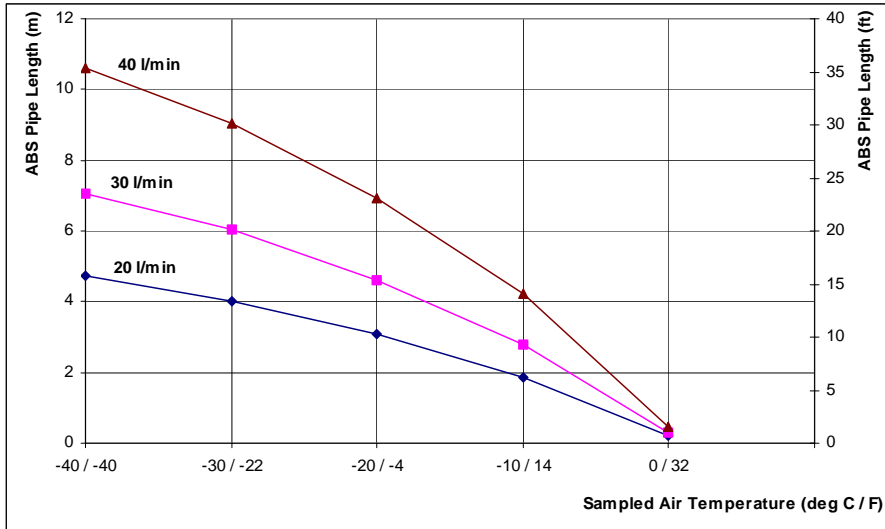


Figure 11 – Chart showing the estimated required ABS pipe extension for sampled air warming.

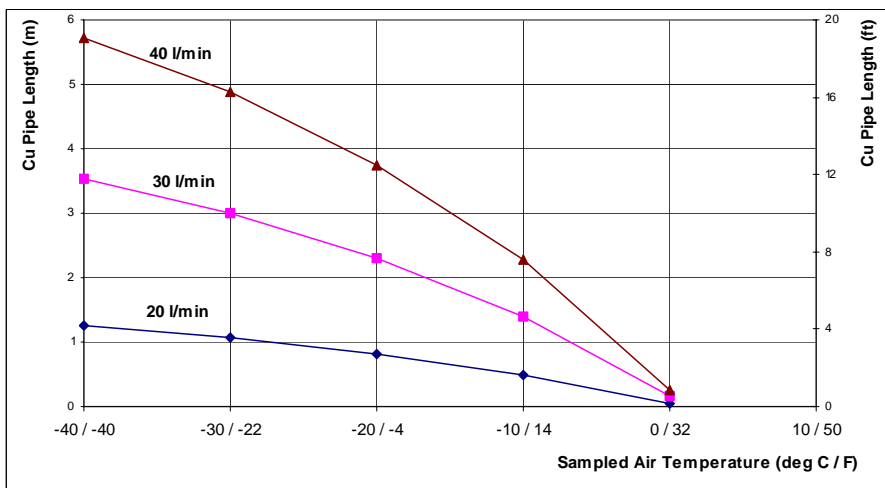


Figure 12 – Chart showing the estimated required Copper pipe extension for sampled air warming.

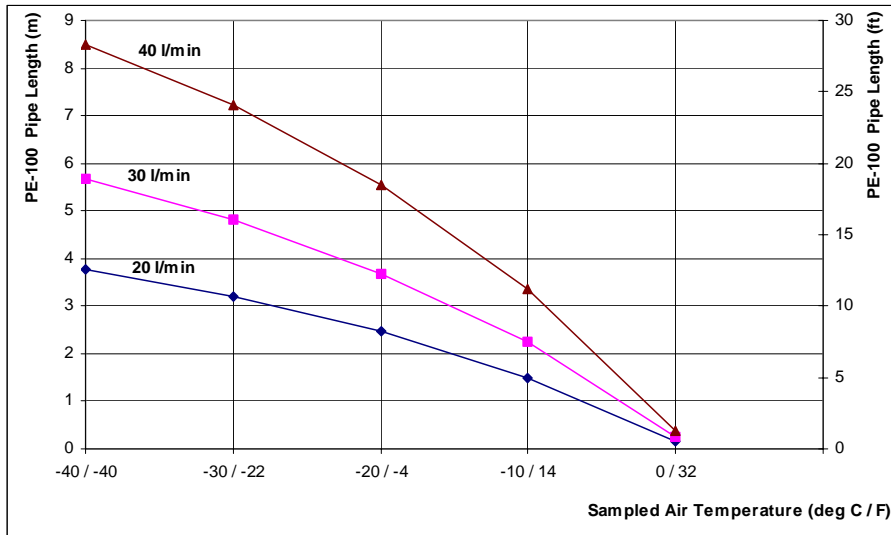


Figure 13 – Chart showing the estimated required PE-80/PE-100 pipe extension for sampled air warming.

5.2 Heat Tracing

In extreme cases where there is no space to run pipe extensions or the external temperature varies widely, heat tracing may be employed for sampled air warming. However, this approach to warming sampled air is NOT recommended by Vision Fire & Security as it has not been validated by Factory Mutual (FM).

Important Note: The Appendix contains information on the copper pipe and heat tape lengths required for sampled air warming. No design guidelines will be given here. If wishing to use heat tracing, appropriately qualified Engineers MUST be consulted as to the most suitable method to be used.

5.3 Exhaust Air Treatment

Air from the VESDA exhaust pipe MUST be returned to the area from which it was sampled as shown below (Figure 14).

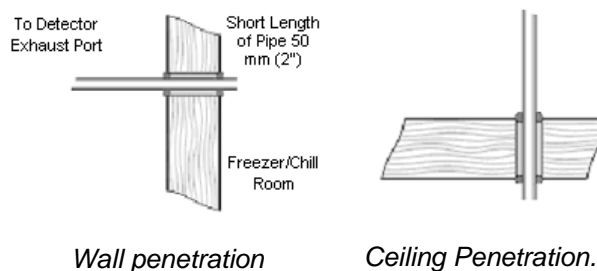


Figure 14 – Examples of a VESDA exhaust pipe being fed back into the area from which the air sample was taken.

This closed loop system will prevent pressure differences, caused when the VESDA detector is powered down for any length of time, from introducing warm and humid air into the refrigerated storage area via the VESDA exhaust port. Pressure differences will also result in unwanted airflow faults.

The return pipe from the exhaust should be as short as possible and its penetration, into the protected area MUST be air-tight.

Important Note: All inlet and exhaust pipes MUST be closed off whenever the system is powered down or detectors are removed for maintenance.

5.4 Water Traps

Water traps are not a requirement of the VESDA smoke detection system. As discussed previously, they are only necessary under vastly varying environmental conditions where internal sample pipe condensation is a possibility. An example of a water trap is shown below (Figure 15).

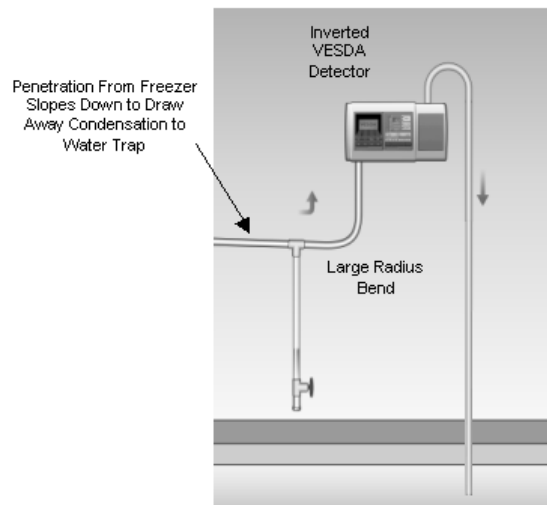


Figure 15 – Example of a water trap.

To install a water trap, a T section of pipe must be fitted to the pipe entering the inverted detector. Water will pool at the stop valve on the downwards pointing arm of the T. The transparent section of pipe allows maintenance personnel to see when water is building up, before it rises above the intersection with the main sampling pipe, and release it via the stop valve. An end cap could be put on the pipe in place of the stop valve. If no condensation is evident after some time, the water trap can be removed.

Important Note: Water trap stop valves and end caps MUST be replaced as soon as the water has been drained. Leaving the pipe open will affect the airflow.

5.5 Integration With Pre-action Sprinklers

The VESDA smoke detection system can also be used to activate pre-action sprinklers, if installed. For the purposes of pre-action sprinkler activation, VESDA protection in-rack is usually not required even where there are in-rack sprinklers. However, it is important to refer to the FM memorandum 0805^[15] for further details.

The procedure for integrating VESDA with pre-action sprinklers is outlined below:

1. Use ASPIRE2 to design the pipe network and determine Maximum permissible Transport Time . For FM approved, refrigerated storage, VESDA installations, sample hole spacing should be the same as heat detector spacing as per the latest edition of the FM8-29 Datasheet and Memorandum 08-05^[1, 15].
2. Install the VESDA pipe network on the ceiling as shown below (Figure 16).

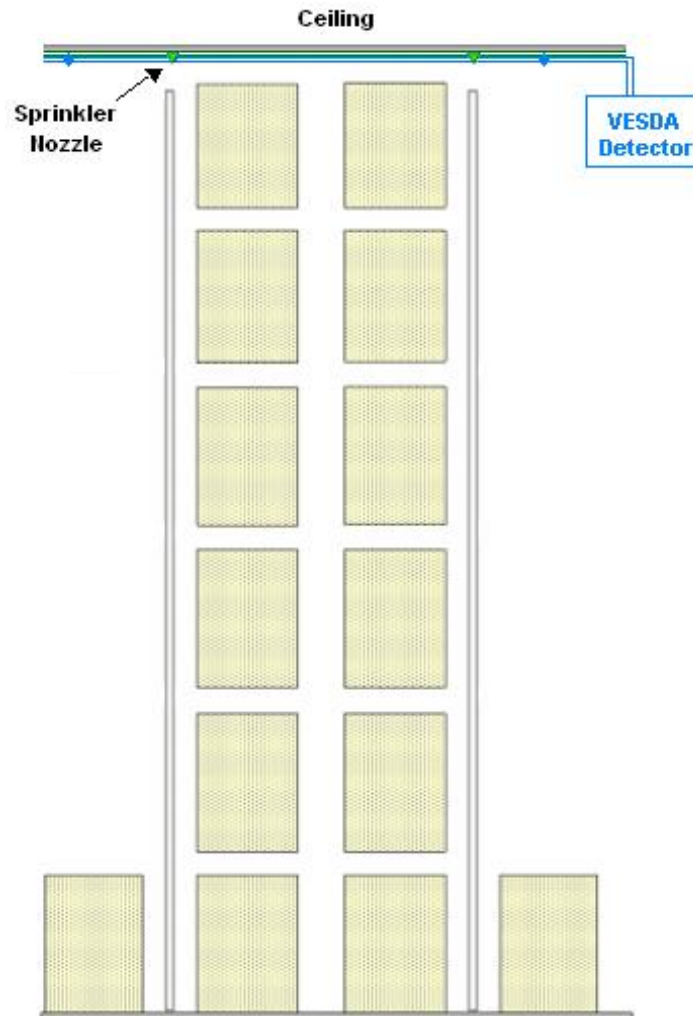


Figure 16 – Arrangement of the VESDA pipe network and sprinkler heads on the ceiling.

3. Set the VESDA **Alert** alarm threshold for early detection and intervention.
4. Set the VESDA **Fire 1** alarm threshold for pre-action sprinkler activation as indicated in Table 4.

Note: Delays can be configured for both of these alarms.

The smoke thresholds in Table 4 are absolute values, hence the environmental background level must be taken into account. All values are recommendations only, actual values being dependent on individual site conditions such as air change rate, storage rack height etc. Before using any values, the system performance **MUST** be verified by the commissioning test (refer to section 6.2).

Any VESDA Fire 1 alarm shall put all sprinkler valves, in that particular fire zone, into armed mode.

Table 4 – Design guidelines for VESDA fire alarm settings^[17].

Enclosure Size	Small < 500 m ² (5400 sq.ft)	Medium 500 – 1000 m ² (5400 – 10800 sq.ft)	Large 1000 – 1500 m ² (10800 – 16200 sq.ft)	Extra Large > 1500 m ² (16200 sq.ft)
Fire Alarm (General 10 m (30 ft) or less)	2%obs/m (0.61%obs/ft)	2%obs/m (0.61%obs/ft)	1.5%obs/m (0.46%obs/ft)	1%obs/m (0.31%obs/ft)
Fire Alarm (High Ceiling more than 10 m (30 ft))	1.5%obs/m (0.46%obs/ft)	1.5%obs/m (0.46%obs/ft)	1%obs/m (0.31%obs/ft)	1%obs/m (0.31%obs/ft)
Maximum Transport Time Allowed per Zone (s)	See Note Below and consult local codes.	110	110	110

Note: For small enclosures, the Maximum Transport Time Allowed is a function of the ceiling height H and equals $0.14H - 0.8H + 80$. If the Maximum Transport Time Allowed cannot be achieved, install additional detectors in the area. If the Transport Time is close to the maximum allowed, consider reducing the fire alarm threshold by 10 to 20% to compensate. Ceiling height restrictions are for FM approval. Remember also to consult local codes and standards for Transport Time requirements.

5.6 Battery Backup

When using a VESDA system for pre-action suppression activation, in the event of a power outage, a secondary power supply **MUST** be available. This power supply needs to be capable of running a single VESDA detector for a total of 90 hours. This is in compliance with the fact that approved control panels for the automatic release of pre-action or deluge sprinkler systems must have 90 hours of standby power plus 10 minutes worth of power to operate the sprinkler system and alarms^[17].

Where the VESDA system is being used for very early warning smoke detection alone, refer to local codes and standards for the battery backup required.

6. Ongoing Considerations

6.1 Running The VESDA System

For a new refrigerated storage facility, it is preferable that the VESDA system be powered up and running while the refrigerators are being commissioned. This allows the detectors to adjust gradually to the decreasing sampled air temperature.

If installing VESDA detectors in an existing facility, it is recommended that the pipe network inside the refrigerated areas be installed first and that all points where pipes exit these areas be blocked off. This prevents humid air being transferred into the protected area from outside. The blockages can be removed once the rest of the pipe network and detectors, outside the refrigerated areas, have been installed and connected.

Note: It may be necessary to construct enclosures around detectors to protect them from the weather or mechanical damage.

6.2 System Commissioning

Once the VESDA system has been installed, its performance and pipe network integrity can be verified using the ASPIRE2 pipe modelling program. A range of sampled air temperatures may be input to determine Maximum Transport Times for each zone. Calculated Transport Times should be applied conservatively. Smoke tests can then be used to check system performance for both smoke detection and pre-action suppression activation.

6.3 Service And Maintenance

The VESDA system shall be serviced and maintained according to both the local codes and standards and the instructions provided in the Maintenance section of the VESDA System Design Manual^[2].

The frequency of sample pipe inspection and testing can be determined by the rate of ice build-up to ensure that sample holes do not become blocked.

7. Appendix – Heat Tracing

There are several techniques for warming sampled air including water heaters, electrically heated tape and passing the pipe through an area that has been heated to 5-10°C (41-50°F). Electrically heated tape is preferred as it is easy to install. An example of a pipe covered with heat tape is shown below (Figure 17). If the surface temperature is over 30°C (86°F), the pipe must be insulated.

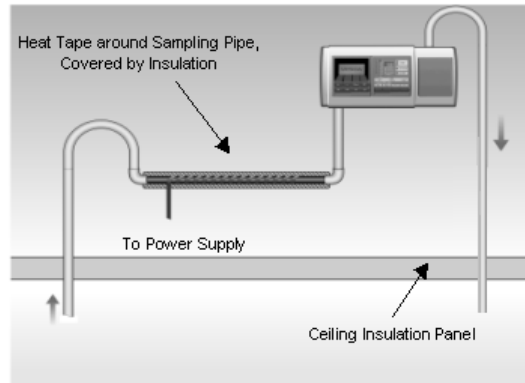


Figure 17 – Example of heat tracing with heat tape.

Raychem heat tape 5BTV2-CT or 3BTV1-CR can be used.

The following charts provide estimates of copper pipe and heat tape lengths required for heat tracing. Variations in ambient temperature are assumed to be negligible due to pipe insulation. The surface of the pipe is kept at a temperature of 35°C (95°F) and the tape is wound around it at 100 mm (4”) intervals along its length.

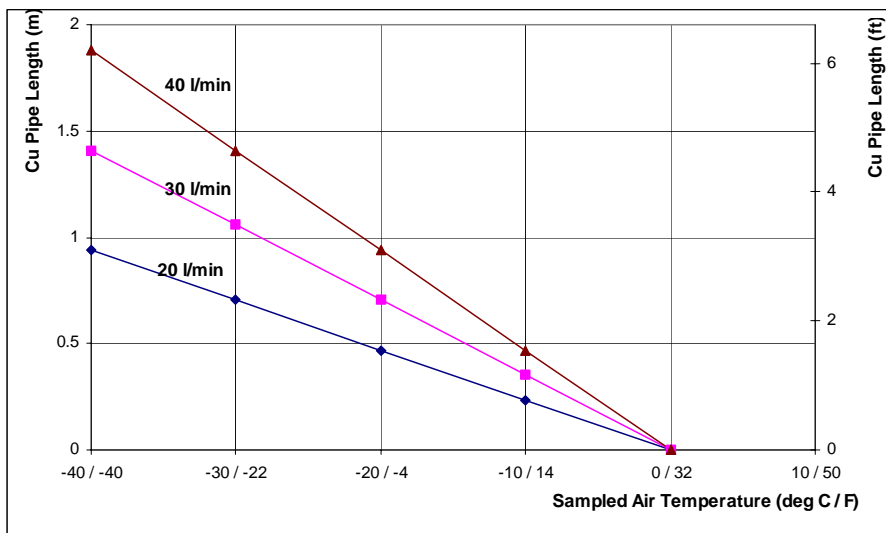


Figure 18 – Estimates of copper pipe length for heat tape.

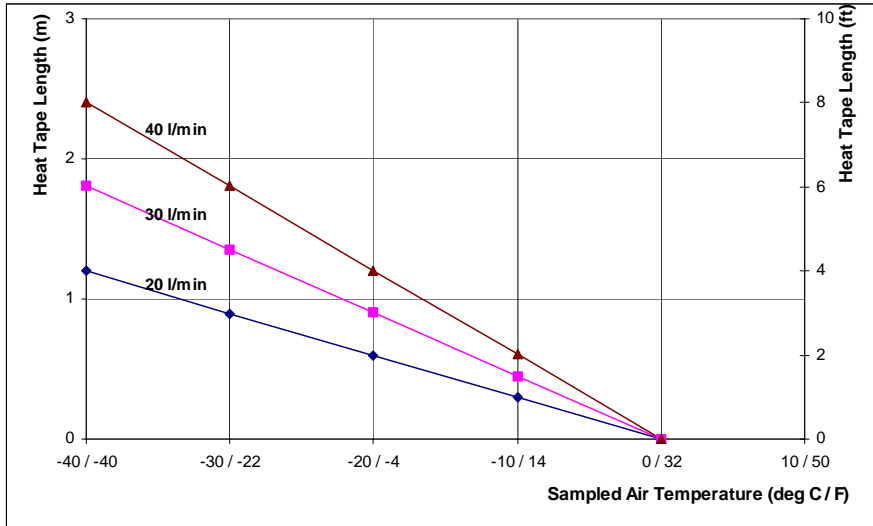


Figure 19 – Estimated heat tape length.

8. References

- [1] FM Global (2000) *Property Loss Prevention Datasheets 8-29*.
- [2] Vision Fire & Security (1997) *VESDA System Design Guide*.
- [3] NFPA Fire Analysis & Research Division (2003) *Selections from the U.S. fire problem overview report. Leading causes and other patterns and trends Storage properties excluding dwelling garages*.
- [4] Australian Government State and Territories of Australia (2005) *International Fire Engineering Guidelines*.
- [5] British Standard BS 7974 (2001) *Application of Fire Safety Engineering Principles to the Design of Buildings – Code of Practice*.
- [6] SFPE (2000) *Engineering Guide to Performance-Based Fire Protection Analysis and Design of Buildings*.
- [7] Australian Standard AS/NZS 4360 (1999) *Risk Management Standard*.
- [8] SFPE (2002) *Handbook of Fire Protection Engineering*, 3rd Edition.
- [9] SFPE & ICC (2004) *The Code Officials' Guide To Performance-Based Design Review*.
- [10] NFPA (2002) *National Fire Alarm Code (72)*.
- [11] The Plastics Pipe Institute, Inc. (1999) *Suggested Temperature Limitations for the Operation and Installation of Thermoplastic Pipes in Non-pressure Applications*, TN-11/99.
www.plasticpipes.org.
- [12] PPFA (2003) *Information & Technical Guide – ABS Pipes & Fittings*, www.ppfahome.org.
- [13] Clipsal (2003) *HFT Conduits & Fittings*, www.clipsal.com.
- [14] Fisher, G. (2002) *Planning Fundamentals Industrial Piping Systems*,
www.piping.georgefisher.com.
- [15] FM (2006) *Memorandum - Engineering Bulletin 08-05*.
- [16] ASHRAE (2003) *Psychometric Chart*, www.ashrae.com.
- [17] FM Global (2003) *Property Loss Prevention Data Sheet 5-40 Fire Alarm Systems*.

Disclaimer On The Provision Of General System Design Recommendations

Any recommendation on system design provided by Vision Fire & security Pty Ltd (VFS) is an indication only of what is considered to be the most suitable solution to meet the needs of the common application environments described.

In some cases the recommendations on system design provided may not suit the unique set of conditions experienced in a particular application environment. VFS has made no inquiry nor undertaken any due diligence that any of the recommendations supplied will meet any particular application. VFS makes no warranty as to the suitability or performance of any recommendation on system design. VFS has not assessed the recommendation on system design for compliance with any codes or standards that may apply nor have any tests been conducted to assess the appropriateness of any recommendations on system design. Any person or organisation accessing or using a recommendation on system design should, at its own cost and expense, procure that the recommendation on system design complies in all respects with the provision of all legislation, acts of government, regulations, rules and by-laws for the time being in force and all orders or directions which may be made or given by any statutory or any other competent authority in respect of or affecting the recommendation on system design in any jurisdiction in which it may be implemented.

VFS products must only be installed, configured and used strictly in accordance with the General Terms and Conditions and the technical documentation available from VFS. VFS accepts no liability for the performance of the recommendation on system design or for any products utilized in the implementation of the recommendation on system design, aside from the General Terms and Conditions. You acknowledge that you have read and agree to the General Terms and Conditions.

No statement of fact, drawing or representation made by VFS either in this document or orally in relation to this recommendation on system design is to be construed as a representation, undertaking or warranty.

To the extent permitted by law, VFS excludes liability for all indirect and consequential damages however arising. For the purposes of this clause, 'consequential damage' shall include, but not be limited to, loss of profit or goodwill or similar financial loss or any payment made or due to any third party.

Recommendations on system design are provided exclusively to assist in design of systems using VFS products. No portion of this recommendation on system design can be reproduced without the prior approval in writing of VFS. Copyright and any associated intellectual property in any such recommendations on system design or documentation remains the property of VFS.